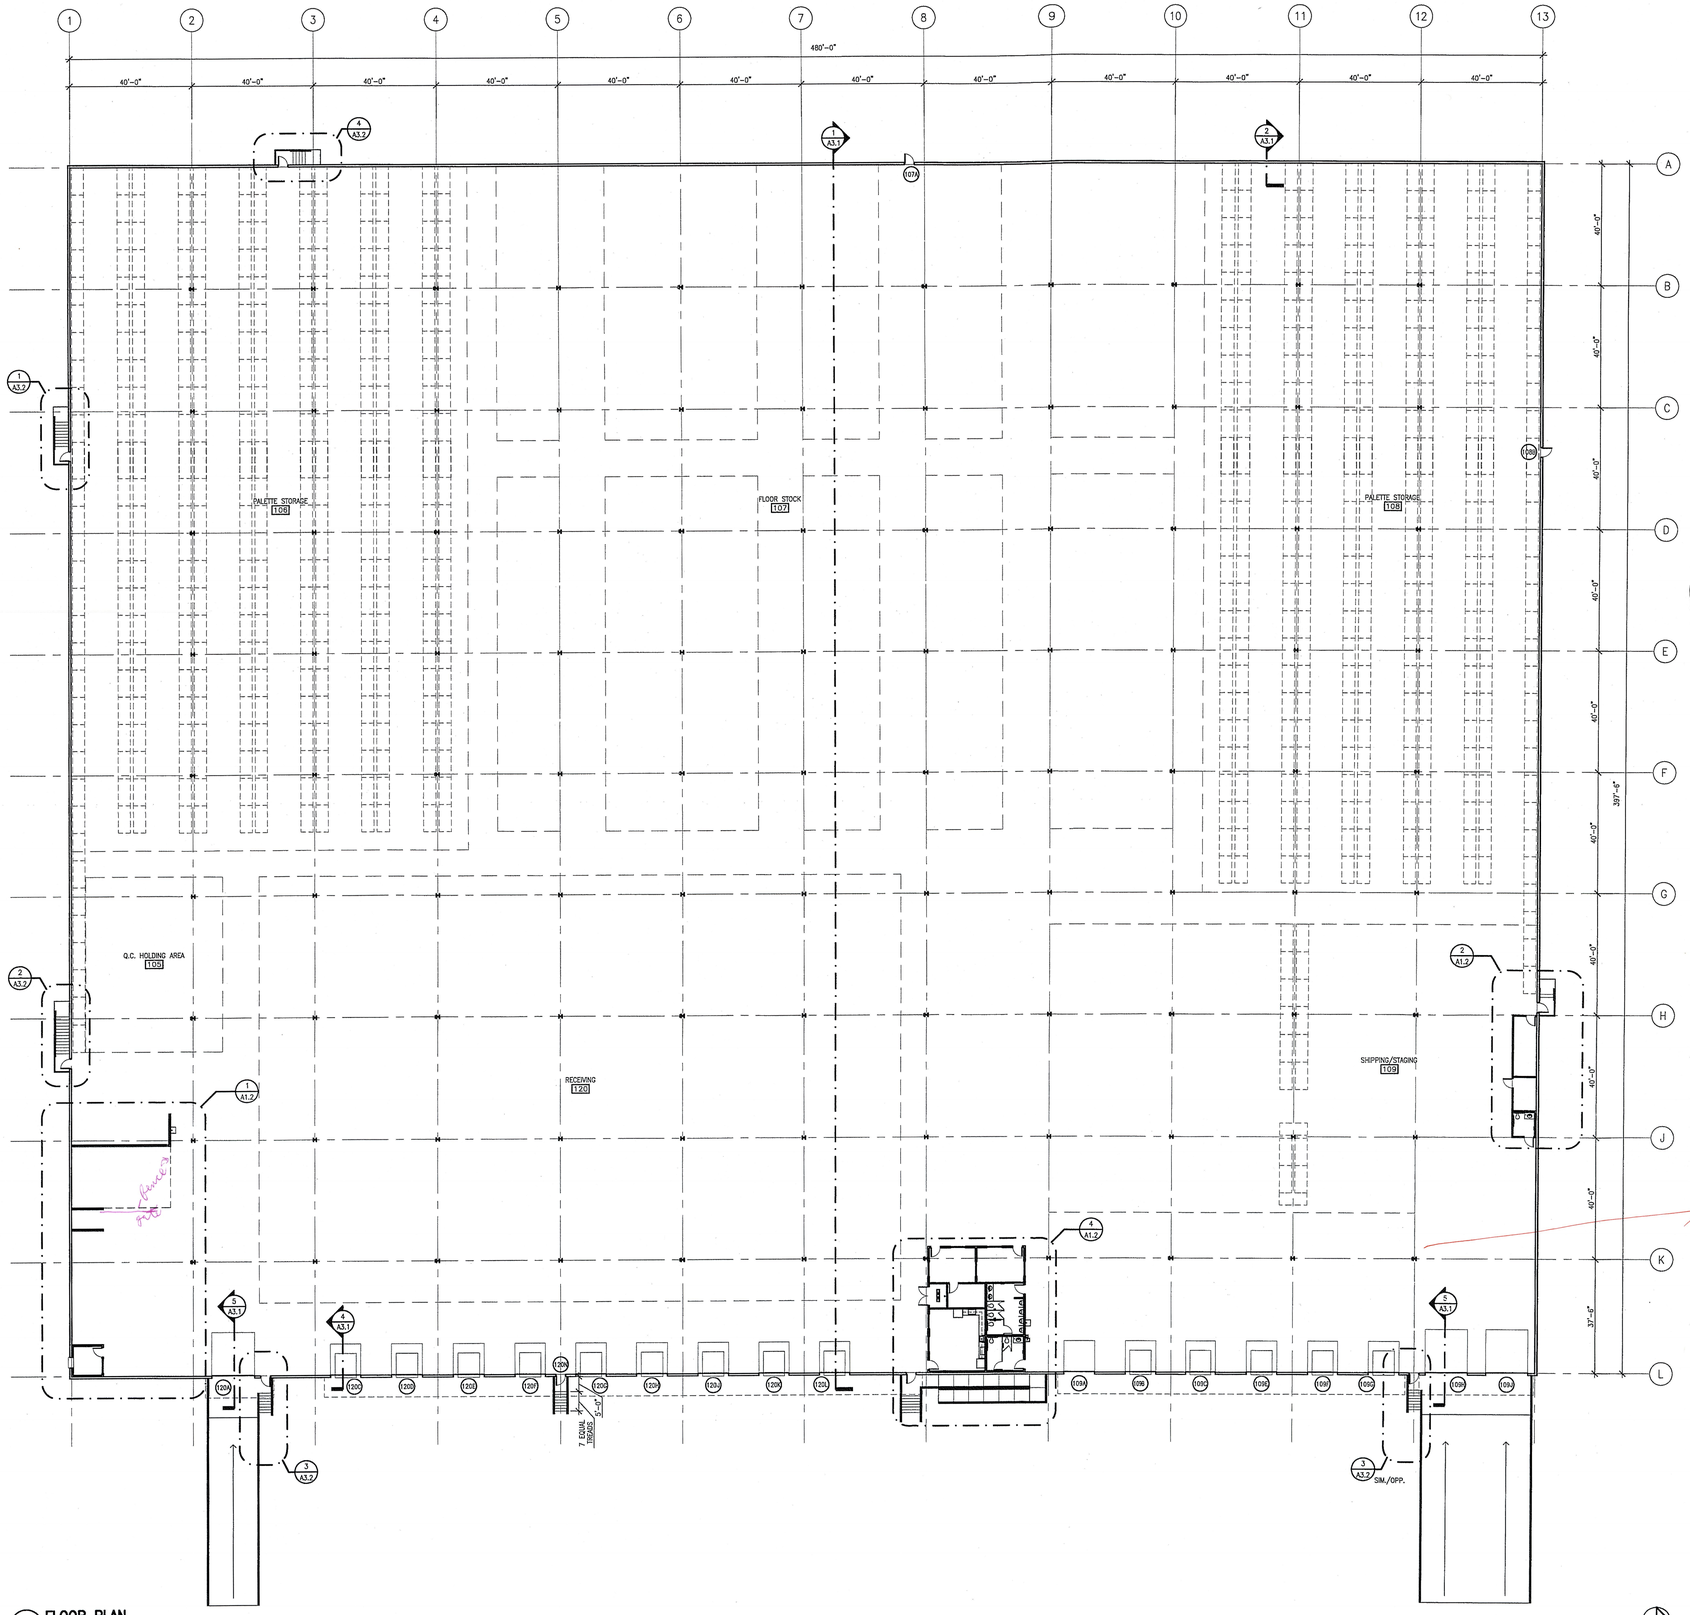

1 FLOOR PLAN
SCALE : 1"=20'-0"

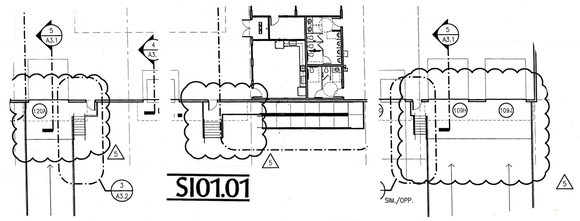

Subject: Fire Extinguisher Requirements RFI 49

Information Requested:

The project documents state that surface mounted fire extinguishers are to be mounted at every other column (75' max radius). Since columns are currently 40' apart, spacing the extinguishers at every other column would exceed the maximum radius of 75'. Does this mean fire extinguishers are to be located at every column? Please advise how the fire extinguishers are to be layed out.

Response Requested By: 2/14/2008

Response:

The fire extinguishers must cover a 75' radial area max, therefore they can be 150' from each other – spacing them at every third column (120' between each other) east to west and every second column (80') north to south will provide the overlap of coverage required. Refer to the attached (Fire Extinguisher Layout.pdf).

Date: 2/7/2008

Surface mounted Fire Extinguishers (Keynote 10.003) shall be mounted at every other column (75' maximum radius).



OVERALL FLOOR PLAN

GRIZZLY DISTRIBUTION CENTER
LYCOMING MALL RD. – Lycoming County, PA

BUTLER, ROSENBURY & PARTNERS, INC.

COPYRIGHT 2007 BUTLER, ROSENBURY & PARTNERS, INC.

DRAWN BY CSA
CHECKED BY GHB
ISSUE DATE MARCH 26, 2007
PROJECT 05133.GRZ4

REGISTERED ARCHITECT COMMONWEALTH OF PENNSYLVANIA GEOFFREY HARVEY BUTLER 3.26.07

A1.1

p:\grz4\dwgs\grz4 project dwgs\sheets\architecture\05133.grz4-a1.1 floor plan.dwg[U.S. 23, 07]23.23 ?:?|jess